



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation

CERTIFICATE NO.: 2024010304662359

NAME AND ADDRESS OF THE APPLICANT

Tripus systems GmbH
Am hohen Rain 2, D-89347 Bubesheim

NAME AND ADDRESS OF THE MANUFACTURER

Tripus Polska sp.z.o.o
ul. Zeromskiego 18, PL-56420 Bierutów

NAME AND LOCATION OF THE FACTORY

Tripus Polska sp.z.o.o
ul. Zeromskiego 18, PL-56420 Bierutów

PRODUCT NAME,MODEL AND SPECIFICATION

AC Contactor
BR01;See attached page for details

STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB/T 14048.4-2020

This is to certify that the above mentioned product(s) complies with the requirements of
implementation rules for compulsory certification(REFNO. CNCA-C03-02:2024).

Valid from: Jul.23,2024

Valid until: Jul.22,2029

The certificate information and validity could be checked by scanning the QR code below or logging in to
the website of the issuing authority, or on the website of the CNCA (www.cnca.gov.cn).



SIGNATURE:

谢肇煦



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.





CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

CERTIFICATE NO. : 2024010304662359

Appendix: Page 1 of 2

BR01

Ui:400V;

Uimp:4kV;

AC-3: Ue/ Ie: 110V/13.5A , 230V/13.5A , 400V/9A;

Ith: 16A;

Us: 230V 50Hz, 400V 50Hz(Not suitable for the number of contacts 22),110V 50Hz(120V 60Hz), 200V 60Hz, 230V 60Hz, 200V DC, 24V DC,24V 50Hz;


Poles: 2P , 3P;

Auxiliary contacts: (body)

1NO, 1NC, 2NC,无;

Ith:NC/NO:10A/16A;

AC-15: Ue/ Ie:400V/6A

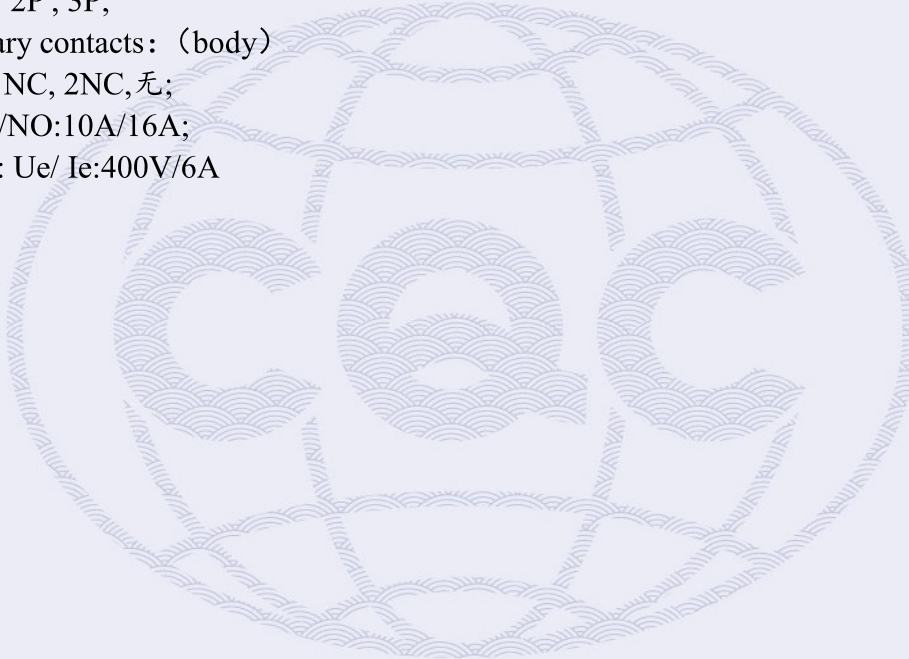

This page is attached to the certificate and should be used at the same time as the certificate page.



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.

本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION


CERTIFICATE NO. : 2024010304662359

Appendix : Page 2 of 2

本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation

型号的解释(Explanation of model/ type):

BR01-XX-XX-XX

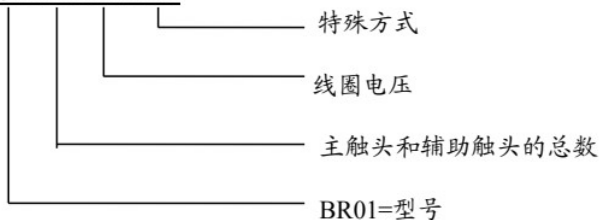

触头数量:

40 = 主触头 3NO
+辅助触头 1NO
31 = 主触头 3NO
+辅助触头 1NC
30 = 主触头 3NO
+辅助触头 0NO
22 = 主触头 2NO
+辅助触头 2NC

线圈电压:

01 = 230V/50Hz
02 = 400V/50Hz (不适应触头数 22)
03 = 110V/50Hz - 120V/60Hz
04 = 200V/60Hz
05 = 230V/60Hz
06 = 200V DC
07 = 24V DC
08 = 24V/50Hz

线圈电压或特殊安装:

01 = 线圈电压 AC
03 = 线圈电压 DC
04 = 可安装在电路板

This page is attached to the certificate and should be used at the same time as the certificate page.



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.